
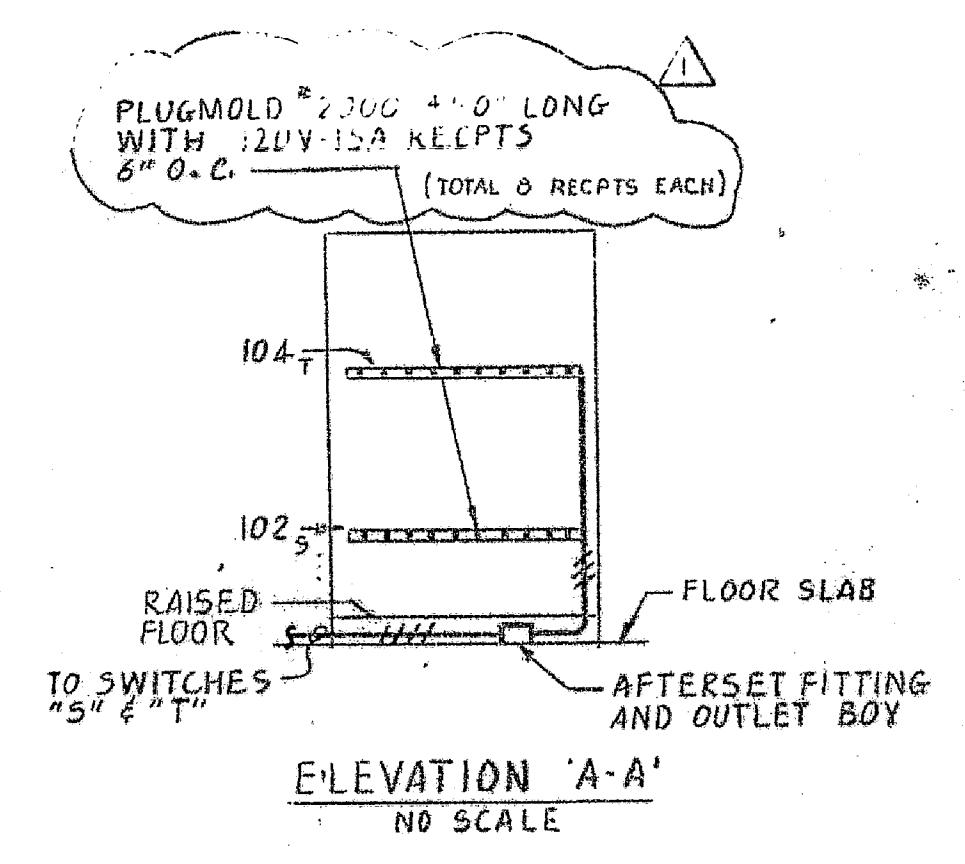
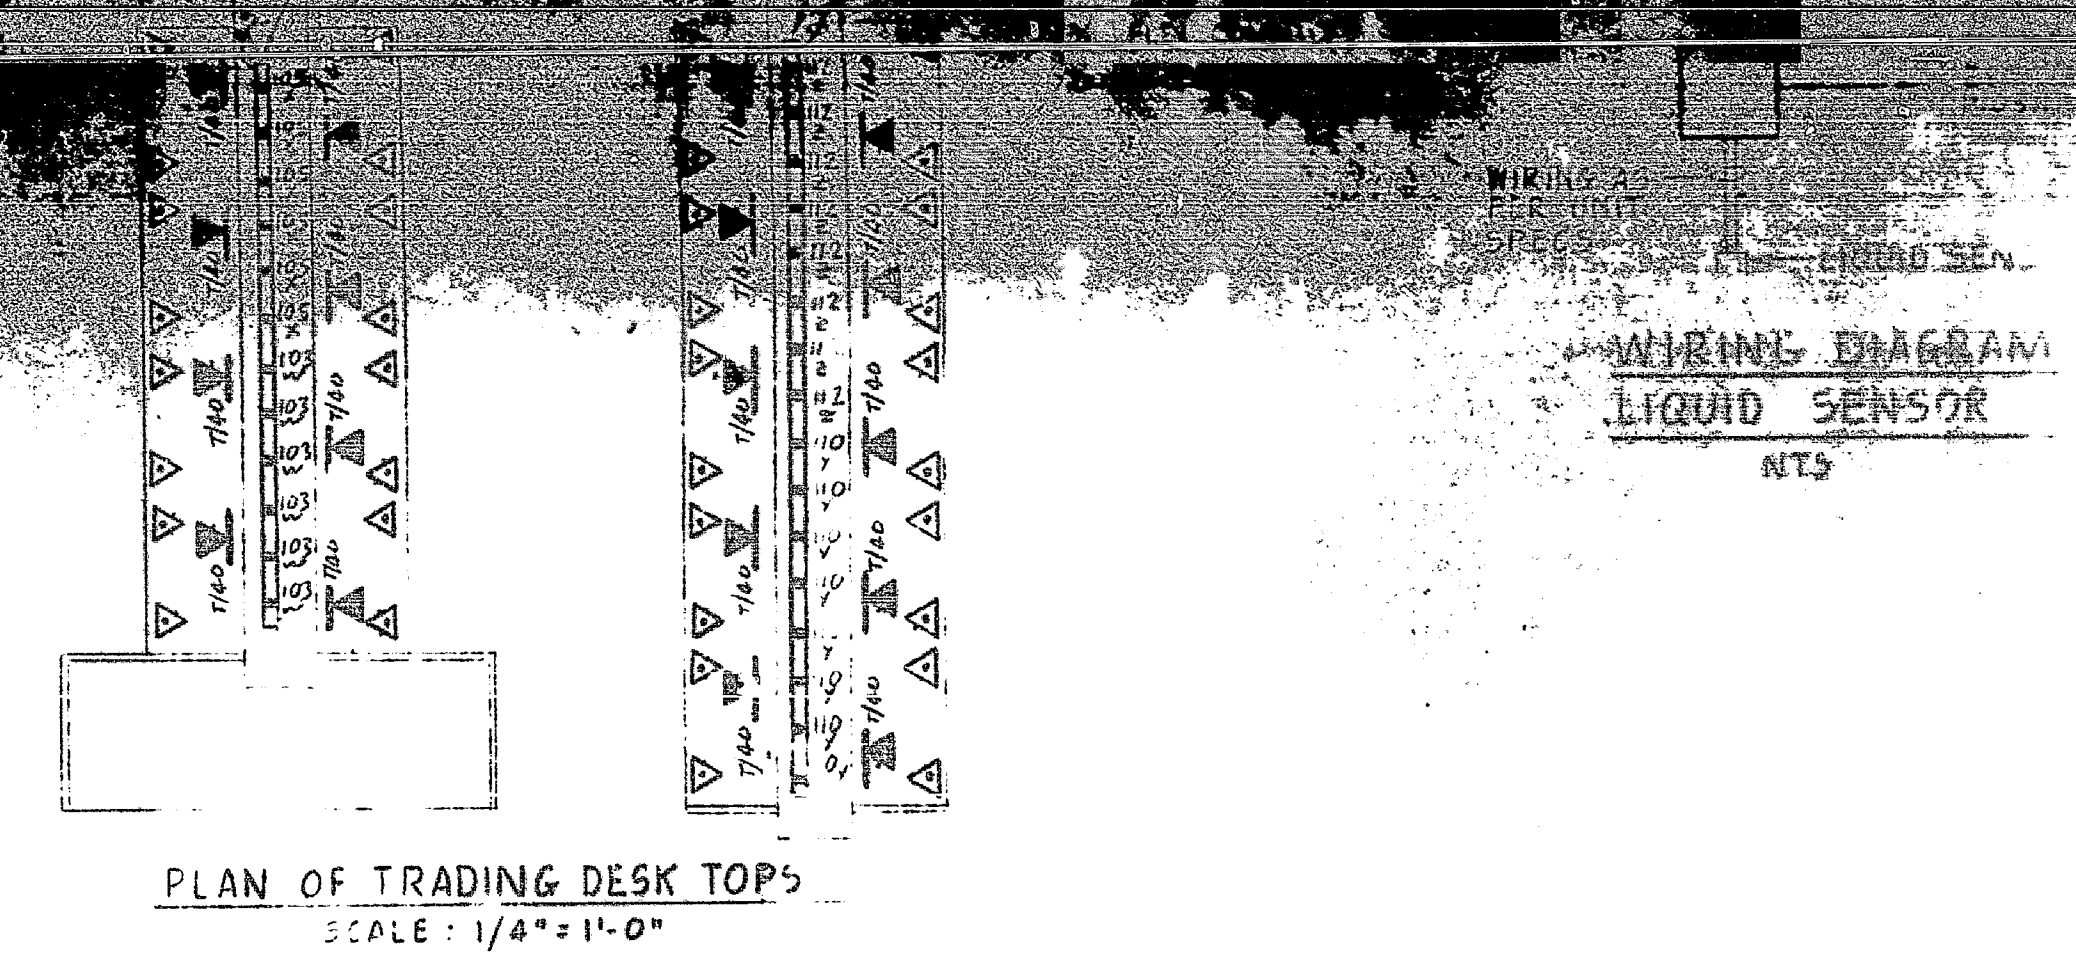


574.119  
Cantor Fitzgerald  
6-3 #1 1-18-85  
A-105

DRAWING NUMBER

DRAWING NUMBER

DRAWING NUMBER

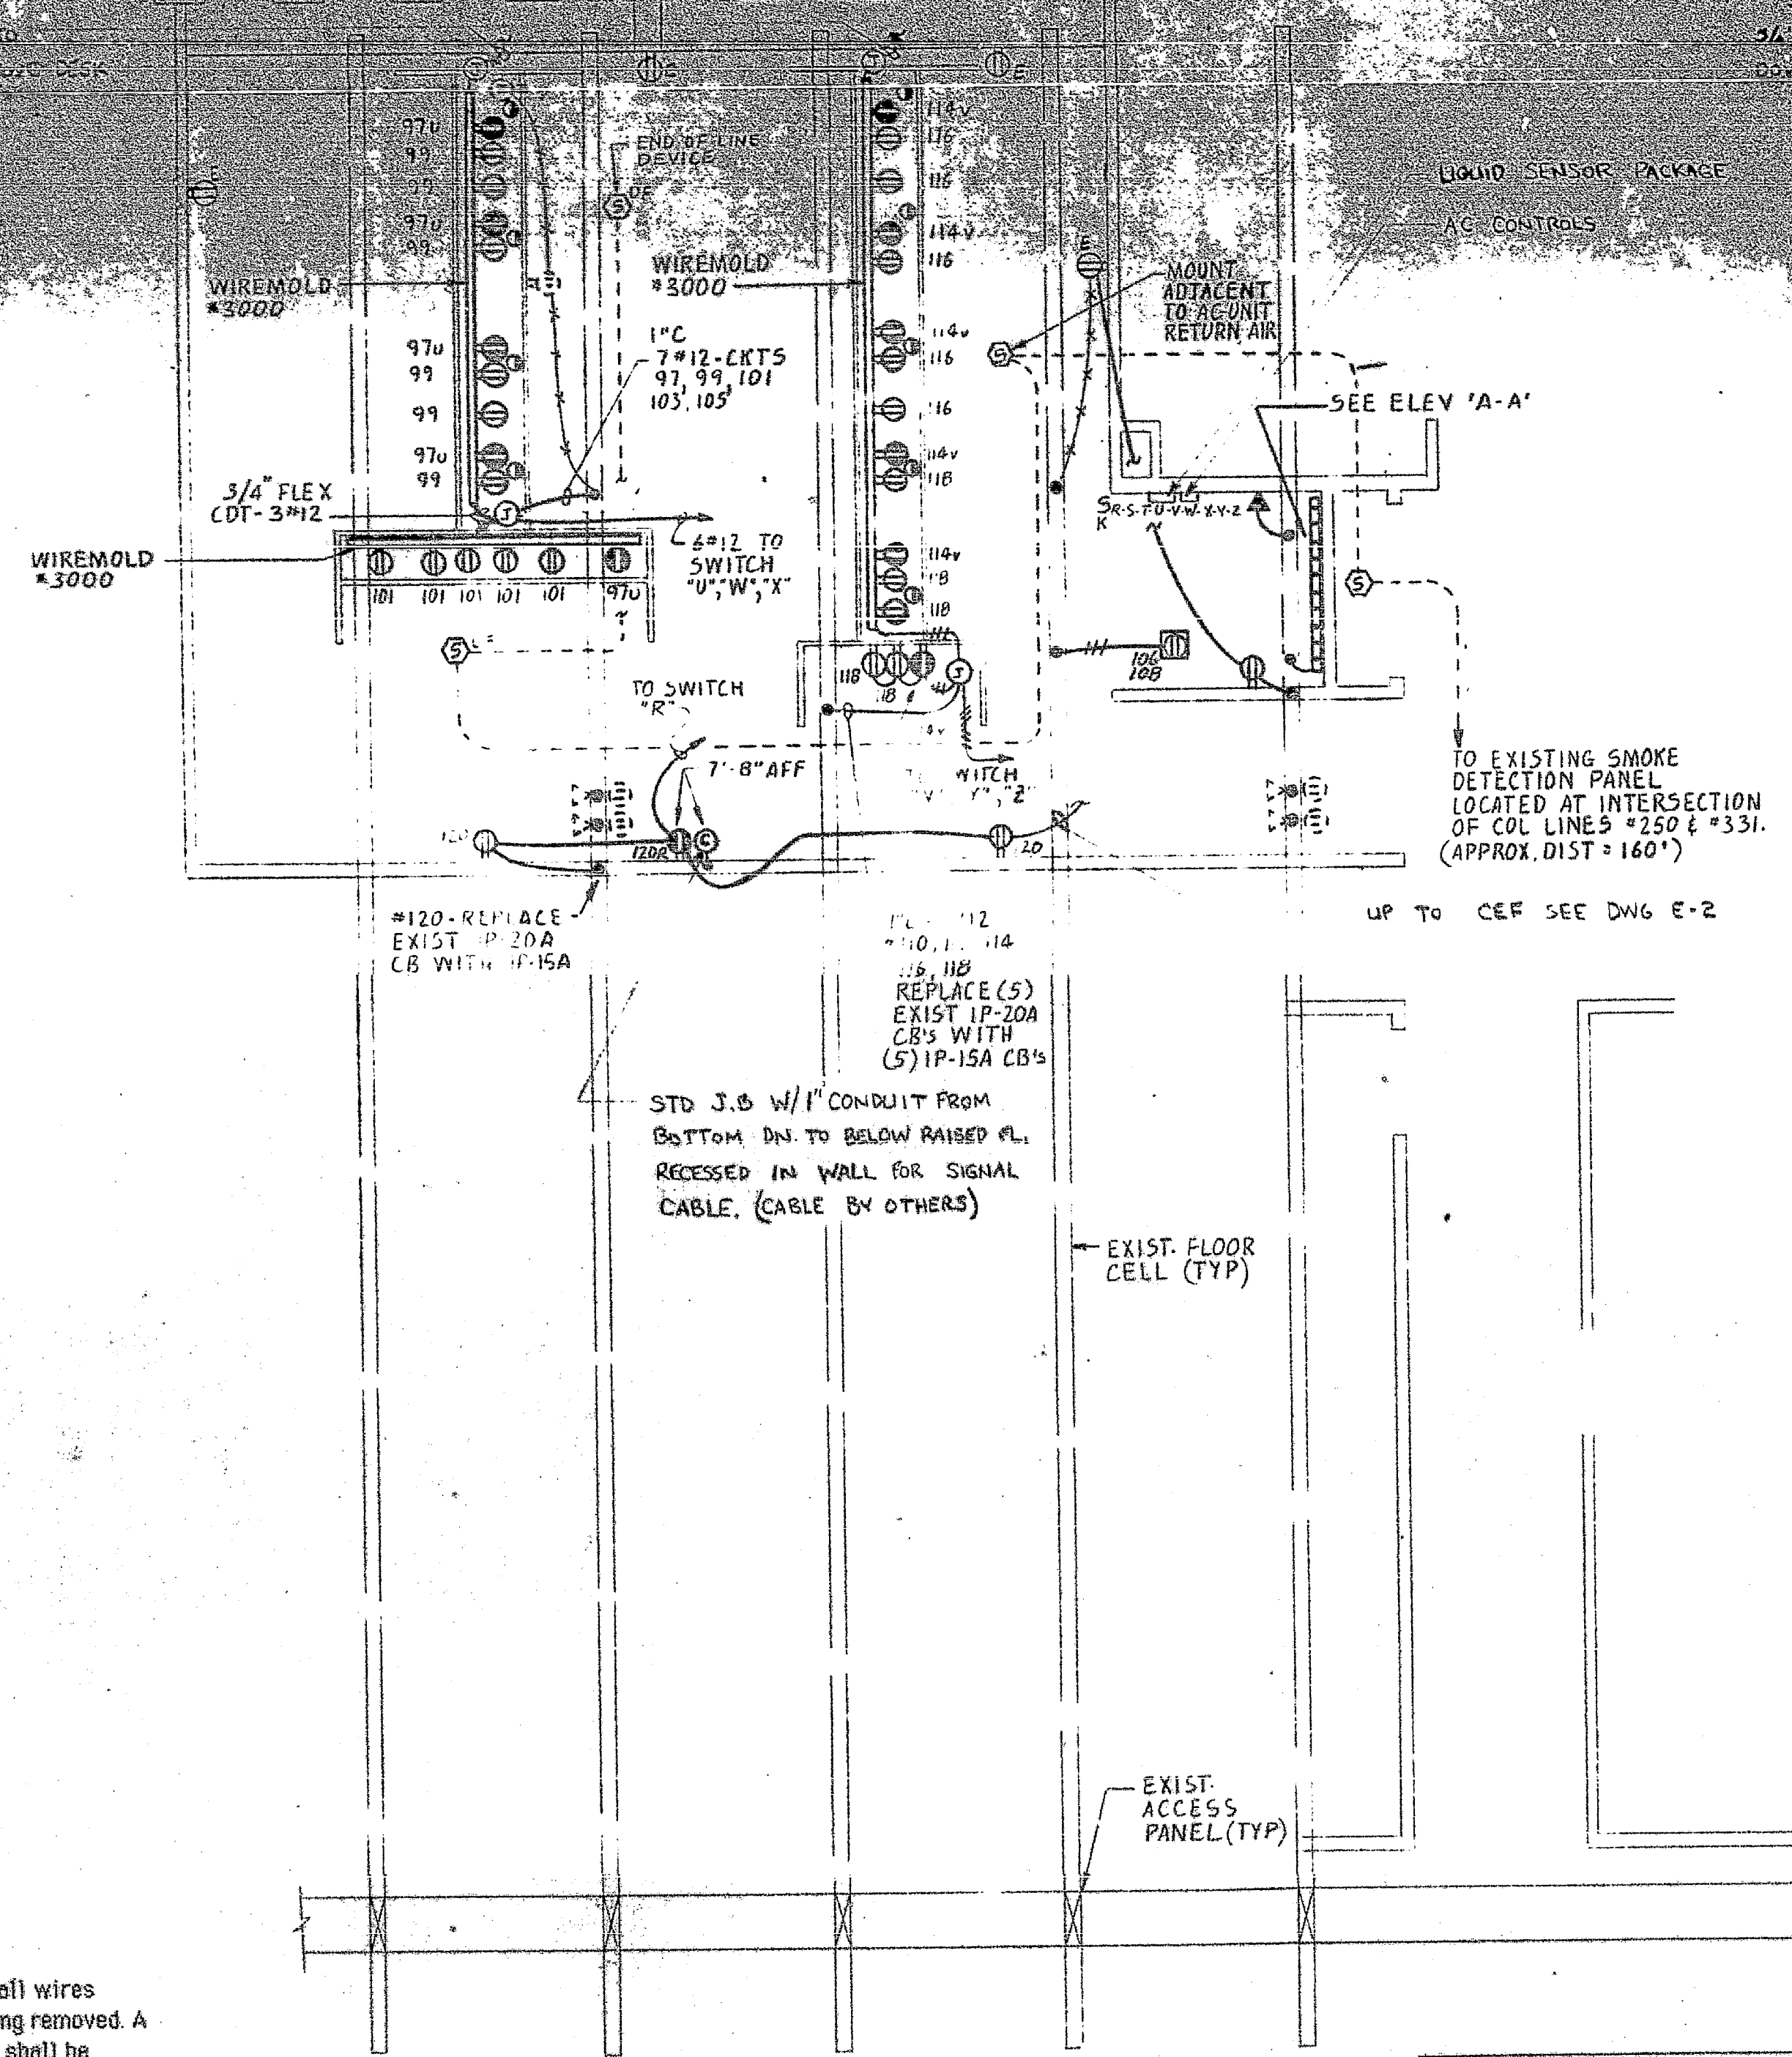


WIRING DIAGRAM  
AC UNIT SHUTDO

- OTHER NOTES**
- All floor outlets to be removed or abandoned shall have all wires removed back to the panel or header duct & the after-set fitting removed. A metal slug shall be installed to cap the P/T cell and the hole shall be filled with concrete adjusted to grade.
  - The Contractor shall install in all after-set fittings two (2) "Palusol" packets (firestop), one on each side of the after-set baffle. Packets can be purchased from the Authority and installed by the Contractor.
  - Items referred to this note may be purchased from Part Authority stock.
  - For Electrical Specifications see DWG E-1
  - All conduits to have a minimum of 2 #12 wires (UL Standard #44) and shall be 3/4" minimum size.
  - Receptacles and lighting outlets are connected to circuits indicated at the end of each underfloor cell unless otherwise noted.
  - No splices are permitted in the underfloor cells. Splices may only be made in the header duct handholes.
  - Device plates shall be brush satin enameled aluminum. Device plates for telephone outlets shall have a bushed hole.
  - All floor outlets and undercell box assemblies being removed and not re-used are to be returned to the Engineer.
  - All panel directories shall be updated to reflect changes due to this contract.
  - The Contractor shall install after-set extensions in those areas where the after-set fitting is not flush with the floor.
  - All telephone and communication wiring not to be re-used shall be removed.

**POWER AND TELEPHONE PLAN**  
SCALE: 1/4" = 1'-0"

NOTE: UNLESS OTHERWISE INDICATED  
CIRCUITS ARE REFERRED TO  
PANEL RPI05NB.

TCA/TAA NO. 3104  
CONTRACT NO. 591.119  
DATE APPROVED 1/28/85

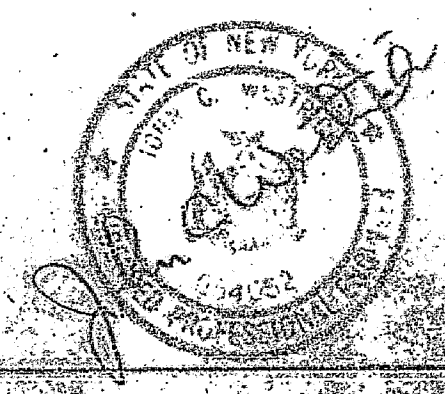

NEW CORPORATE BOND TRADING  
CANTOR FITZGERALD SECURITY  
ONE WORLD TRADE CENTER FLOOR 1005  
NEW YORK, N.Y. 10048

**POWER & TELEPHONE PLAN**

**JOHN C. WESTRICK & ASSOCIATES**  
CONSULTING ENGINEERS  
2110 MAPLE AVENUE  
SOUTH PLAINFIELD, N.J. 07080